

**SKETCH SHOWING**

PROPOSED H.T. OVER HEAD MAINS EXTENSION FROM EXISTING SAAD ULLAH PMT TO ENERGIZE THE PROPOSED 250 KVA P.M.T. AND TAKING OUT L.T. 240 mm<sup>2</sup> U/G CABLE FROM PROPOSED P.M.T. TO PROPOSED POINT OF SUPPLY FOR PROVIDING ELECTRICITY TO M/S, **G.B. MARBLE** AT PLOT NO. D - 05, SURVEY NO. 30 TOP MANGHO PIR AURANGI KARACHI


IND

N/C

I. D. NO. 101418421  
 TOTAL LOAD 180 KW  
 FEEDER LAKHANI  
 GRID STATION VALIKA  
 TRAF0

**NOTE:-**

THIS DRAWING IS VERIFIED BY H.T OPN/UGM VIDE EMAIL FROM GM CM ORANGI CLUSTER ON DATE 20 - 06 - 2019, AT 10:58 am.

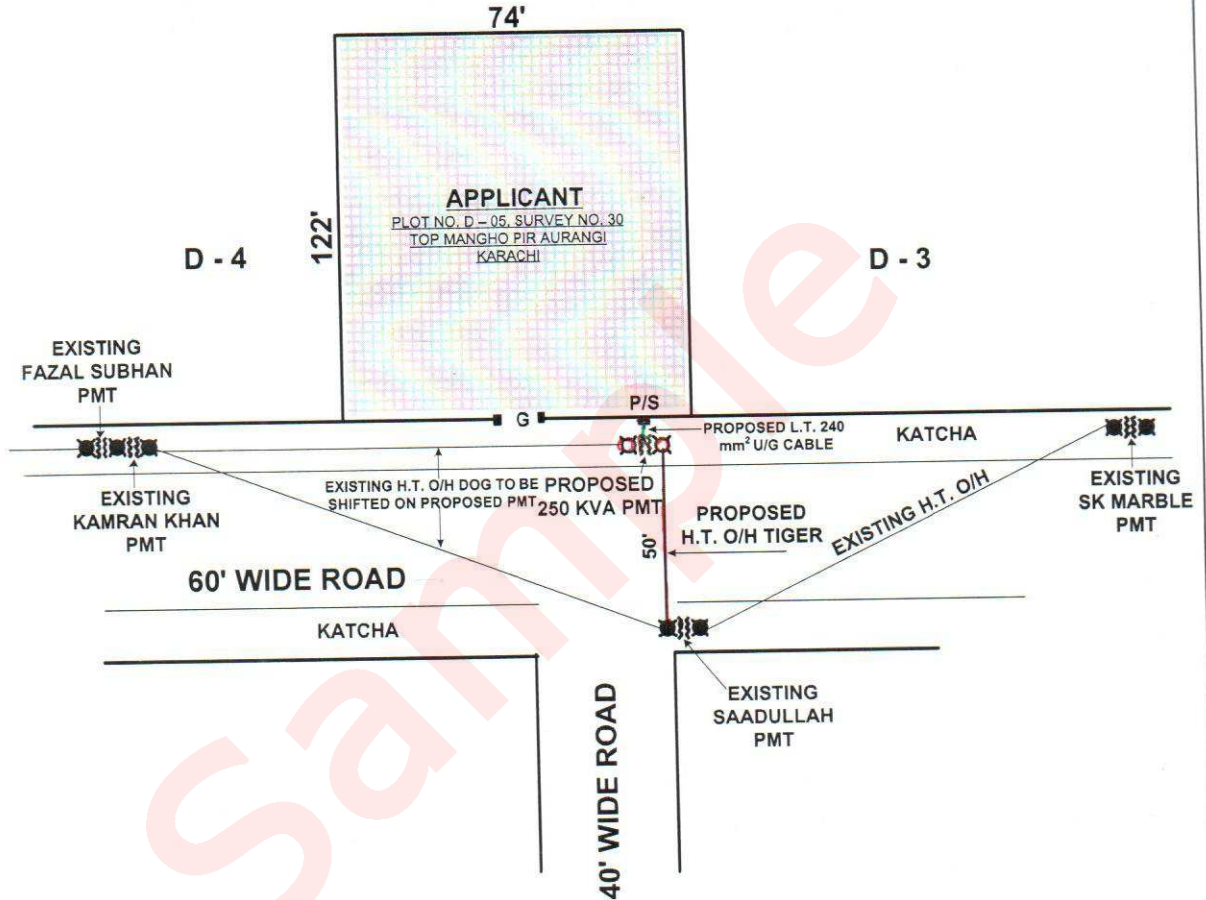

**LEGEND**

	INDICATE EXISTING H.T. CABLE.....	
	..... PROPOSED 250 KVA PMT.....	= 01 NO.
	..... H.T. 5 1/2" X 36' POLES.....	= 02 Nos.
	..... L.T. 240 mm <sup>2</sup> U/G CABLE.....	= 20 m.

Designation	Surveyed by Asstt. Engr. Const. (R-I, II)	Drawing By Tracer CAD N.C (R-I&R-II)	Deputy. Manager Planning N.C (RI)	Manager Planning N.C (R-II)	General Manager Planning & Constructions
Signature by	Muhammad Kaleem	Irfan Hussain	Ammara Tanveer	Kashif Ali Shaikh	Waqar Ahmed
Signature					
Date.				27/06/19	27/6/19



M/S. G.B. MARBLE  
 PLOT NO. D - 05, SURVEY NO. 30  
 TOP MANGHO PIR AURANGI  
 KARACHI

DRG NO. 675 / 2019  
 DATED. - 25 - 06 - 2019

Yr	2019
Sn	222
m	06